



ENCCELUM I/O MODULE-TO-OCCUPANCY SENSOR WIRING TABLE

ENCCELUM I/O MODULE	ENCCELUM I/O MODULE	SENSOR SWITCH CM-PDT	MYTECH DMNI-DT/US	WATT-STOPPER DT-305
VIDOLET	RED (12-24 VDC)	RED (+24 VDC)	+24 VDC (RED)	
GREY	BLACK (COMMON)	BLACK (COMMON)	COMMON (BLACK)	
ORANGE	WHITE (OUTPUT)	BLUE (CONTROL)	CONTROL (BLUE)	
BLACK (NOT USED)	OTHERS (NOT USED)	OTHERS (NOT USED)	OTHERS (NOT USED)	
BLACK (NOT USED)				
BLACK (NOT USED)				

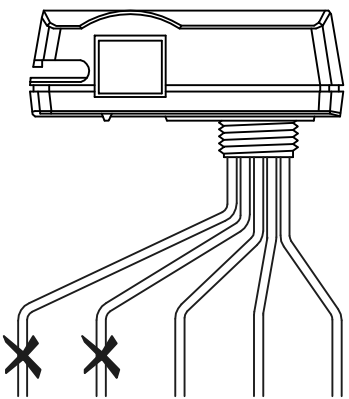


ENCCELUM I/O MODULE

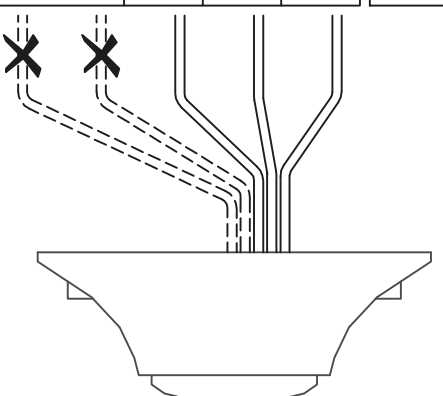

OCCUPANCY SENSOR

ENCCELUM I/O MODULE - WIRE TABLE

VIDOLET	OUTPUT RATING: 0-24 VDC, 25 mA MAXIMUM
GREY	COMMON (-)
ORANGE	SIGNAL
BLACK (X2)	NOT USED WITH OCCUPANCY SENSORS

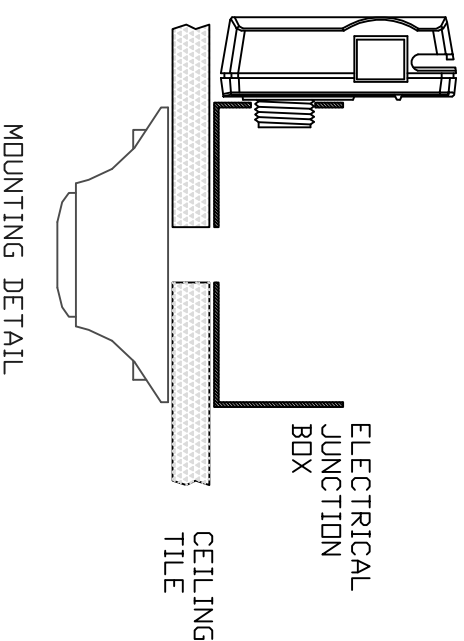

MOUNTING DETAIL

- NOTES:
1. ADJUST TIME DELAY SETTING TO MINIMUM LEVEL ACCORDING TO MANUFACTURER'S INSTRUCTIONS.
  2. OCCUPANCY SENSOR POWER PACK IS NOT REQUIRED.
  3. WIRE UNIT IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL AND BUILDING CODES.
  4. USE OF ELECTRICAL JUNCTION BOX RECOMMENDED.
  5. REFER TO ENCCELUM UNIVERSAL IO-MODULE INSTALLATION AND SERVICE MANUAL BEFORE INSTALLING OR SERVICING MODULE.
  6. CONTACT ENCCELUM FOR COMPATIBILITY WITH OTHER SENSORS.

REV	DESCRIPTION/CHANGE	DATE

SCALE	NTS	PROJ. NO.	
DRAWN	A. PARKER	DWG. NO.	CS-05-10M
DATE	18-JUN-04	FILE NAME	CS-05-10M.dwg
TITLE	OCCUPANCY SENSOR-10M		

ENCCELUM	TEL: 905-731-7678
68 LEXX GRESBENT, UNIT A • RICHMOND HILL, ON L4B 1H1 • CANADA	FAX: 905-731-1401
	www.encelium.com