



ENCCELUM I/O MODULE-TO-PHOTO SENSOR WIRING TABLE

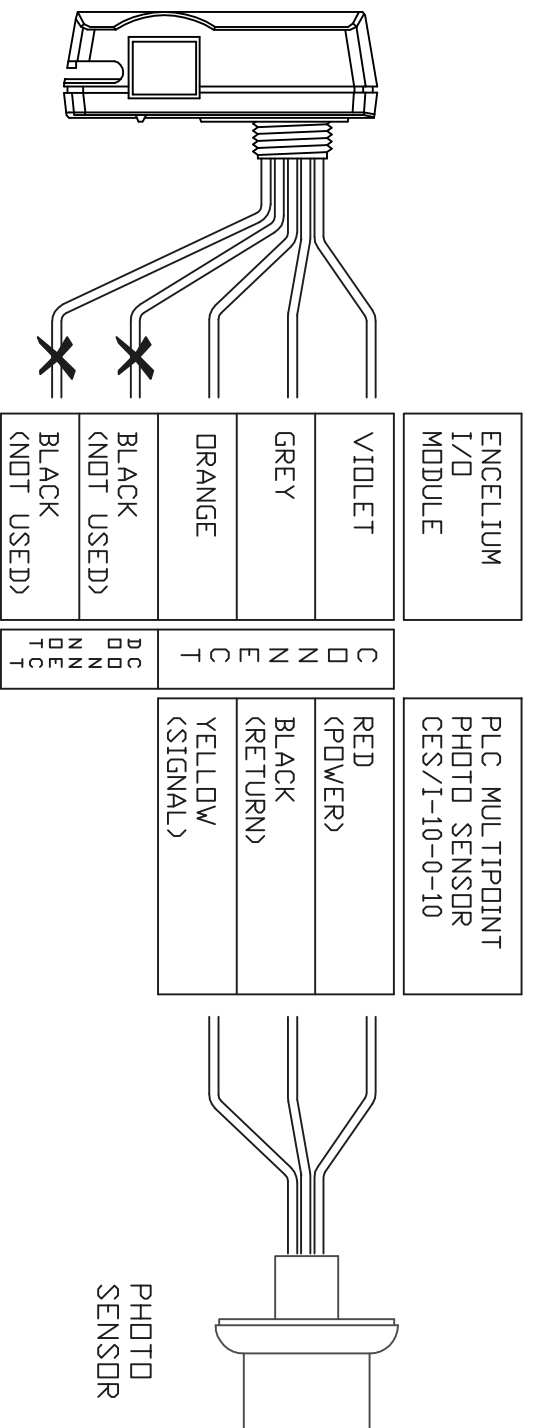

ENCCELUM I/O MODULE

ENCCELUM I/O MODULE - WIRE TABLE	
VIOLET	OUTPUT RATING: 0-24 VDC, 25 mA MAXIMUM
GREY	COMMON (-)
ORANGE	SIGNAL
BLACK (X2)	NOT USED WITH PHOTO SENSORS

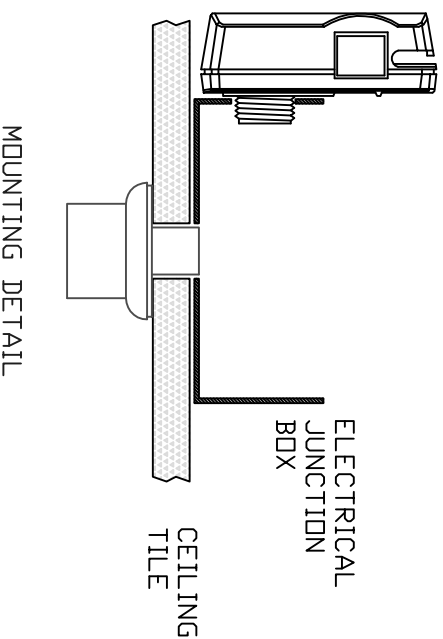

NOTES:

1. WIRE UNIT IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL AND BUILDING CODES.
2. USE OF ELECTRICAL JUNCTION BOX RECOMMENDED.
3. REFER TO ENCCELUM UNIVERSAL I/O MODULE INSTALLATION AND SERVICE MANUAL BEFORE INSTALLING OR SERVICING MODULE.
4. CONTACT ENCCELUM FOR COMPATIBILITY WITH OTHER SENSORS.

REV	DESCRIPTION/CHANGE	DATE

		TEL: 905-731-7678 FAX: 905-731-1401 www.encellum.com
68 LEEK CRESCENT, UNIT A • RICHMOND HILL, ON L4B 1H1 • CANADA		
TITLE PHOTO SENSOR-IOM		
SCALE	PROJ NO.	SIZE
NTS		A
DRAWN A. PARKER	DWG. NO. CS-PS-IOM	
DATE 16-SEP-04	FILE NAME CS-PS-IOM.dwg	