


ENERGY REPORTING MODULE (ERM)

The Encelium Energy Reporting Module is an extremely powerful software tool that reports on energy performance, energy cost savings, occupancy data and building lighting use in a wide variety of formats.

Features:

- The software enables a customer to review and compare energy savings against a configurable energy baseline by providing analytical reports with charting capabilities. The specific details of a building and existing lighting energy use are input into the software to set the baseline and the software takes over from there.
- The customer can run reports on an entire space (building), multiple zones, single zones and even down to an individual fixture level to view data on energy savings. The savings can even be broken down by individual light management strategy deployed (task tuning, load shedding, personal control, daylight harvesting and occupancy sensing) to provide unparalleled analytical data allowing for optimal energy performance.
- Reports may be generated and displayed in several convenient formats as required by the customer such as bar charts, pie charts or line graphs.
- Energy Savings may be expressed as dollars saved, kilowatts saved or as a percentage saving over the baseline values.

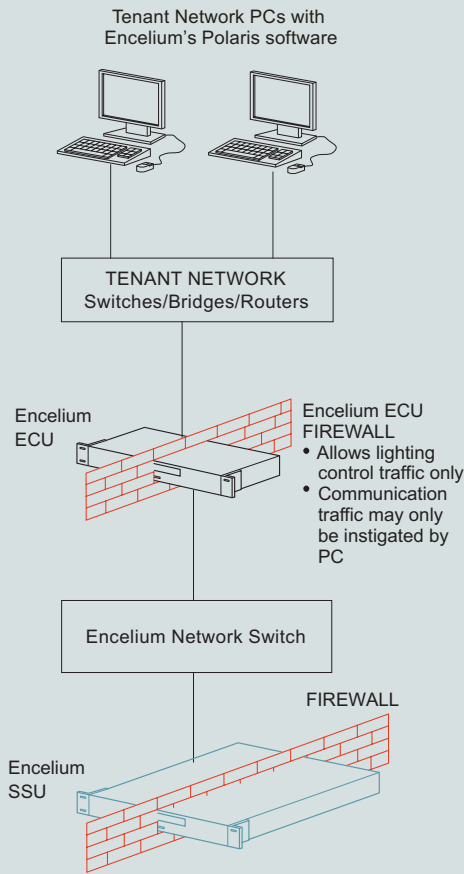


Typical networking connections to enable Polaris lighting control. ■

ENERGY SAVINGS - PIE CHART


Consumption Savings and Demand Reduction by strategy

compared to pre ECS installation, averaged over 29/07/2007 to 25/08/2008

Consumption Savings

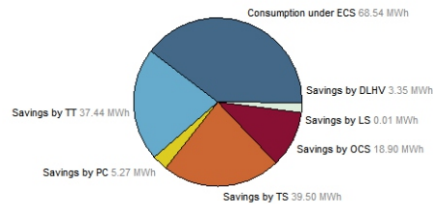


Demand Reduction

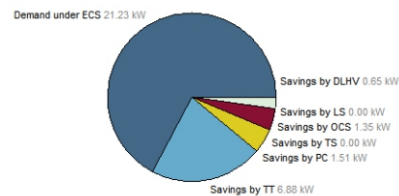

- Consumption Savings
 - Consumption under ECS
 - Savings by TT
 - Savings by PC
 - Savings by TS
 - Savings by OCS
 - Savings by LS
 - Savings by DLHV
- Demand Reduction
 - Demand under ECS
 - Savings by TT
 - Savings by PC
 - Savings by TS
 - Savings by OCS
 - Savings by LS
 - Savings by DLHV

⚠ Demand Calculation based on a 15 minute (real) sliding window, not synchronized to billing intervals. Actually billed demand is typically more favourable.
 ⚠ Demand reduction achieved within the partial month at the beginning and/or at the end of this period have been considered as valid for the respective entire month.

Consumption and Demand Reduction - Bar Graph

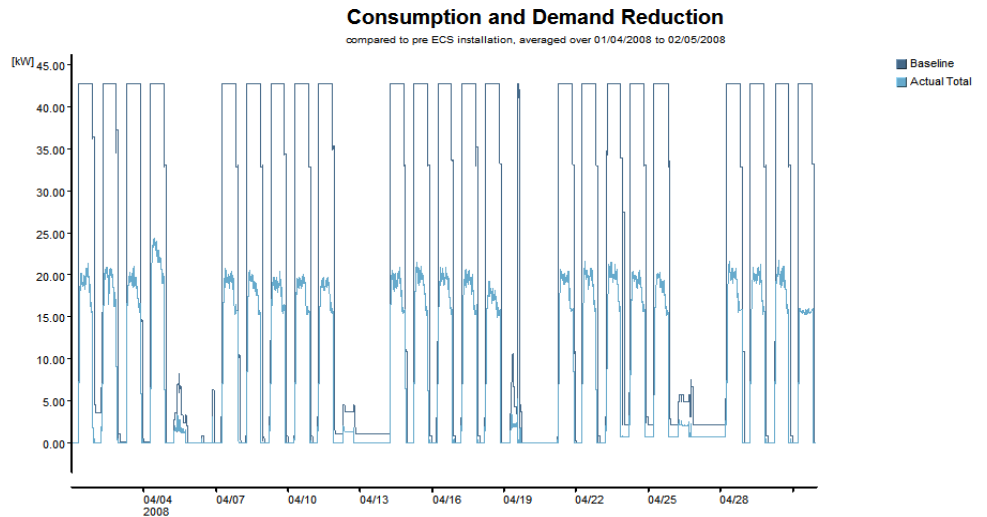

⚠ Demand Calculation based on a 15 minute (real) sliding window, not synchronized to billing intervals. Actually billed demand is typically more favourable.
 ⓘ This Area is not physically (sub)metered. This analysis therefore only considers the lighting load based on a virtual meter. Demand reductions might not coincide with billed demand peak.

- Zone level occupancy data (and reports) are also available allowing for optimization of occupancy sensor control strategies.

Format/Exporting

- Various chart formats available including line and pie charts, gantt charts, color maps and bar graphs
- Reporting done through Encelium Polaris software.
- Exporting
 - Export and save chart images to bitmap (bmp) format for use in other applications and company report documents
 - Export Data to comma separated variable (csv) format for use with Microsoft Excel or other programs
 - Customized reports available

SYSTEM REQUIREMENTS

- Operating System: Microsoft Windows XP/Vista/Windows 7
- Min. 1 GHz Processor
- Min. 200 MB hard drive space
- Min. 512 MB RAM
- Network connection with access to a network-enabled Encelium ECU or direct access to the site Encelium Network

Cat. # ERM-600**ENCELIUM**

CORPORATE HEAD OFFICE
500 Frank W. Burr Boulevard
Floor 1, Suite 29
Teaneck, NJ 07666 U.S.A.
Tel. 1.201.928.2400
Fax. 1.201.928.4028

CANADIAN OFFICE
68 Leek Crescent - Unit A
Richmond Hill, ON L4B 1H1
CANADA
Tel. 1.905.731.7678
Fax. 1.905.731.1401

TECHNICAL SUPPORT
1.888.531.7573

EMAIL technicalsupport@encelium.com
WEB www.encelium.com/technicalsupport