




ENCELLIUM I/O MODULE-TO-DIMMING MODULE WIRING DIAGRAM

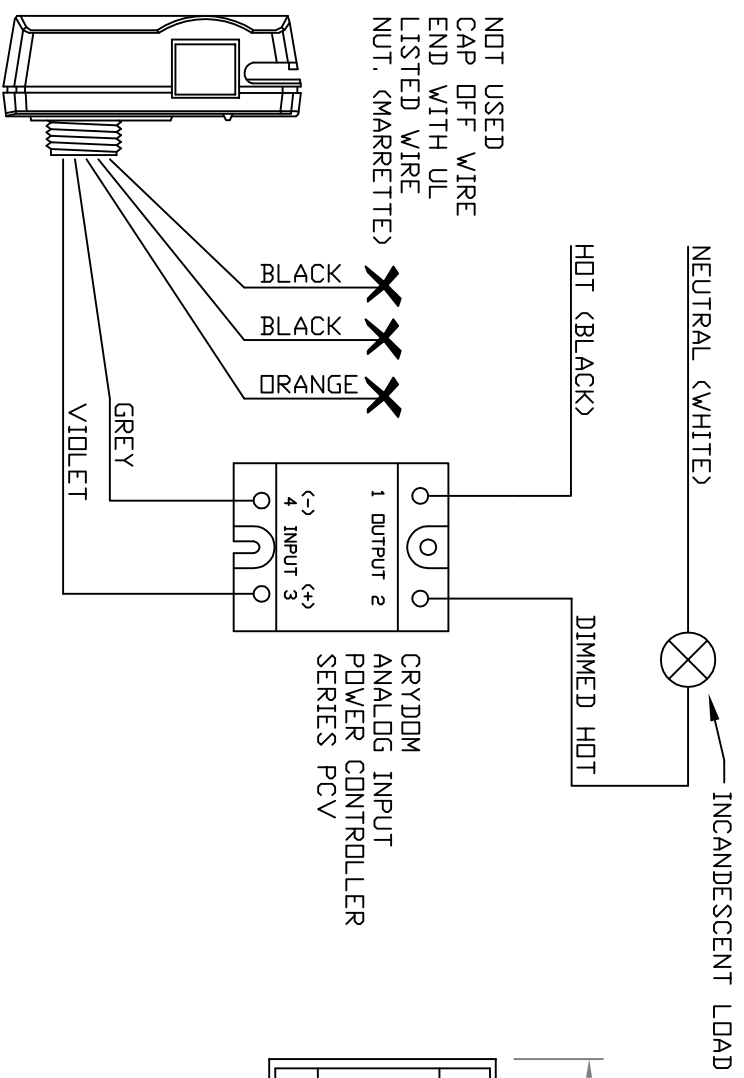

ENCELLIUM I/O MODULE - WIRE TABLE

BLACK	NOT USED
BLACK	NOT USED
VIOLET	(+) CLASS II, LOW VOLTAGE, 0-24 VDC, 25 mA MAX.
GREY	(-) CLASS II, LOW VOLTAGE RETURN, COMMON.
ORANGE	NOT USED

- NOTES:**
1. REFER TO MANUFACTURERS SPECIFICATIONS FOR LOAD LIMITS AND DETAILED INSTALLATION INSTRUCTIONS.
 2. WIRE UNIT IN ACCORDANCE WITH ALL APPLICABLE ELECTRICAL AND BUILDING CODES.
 3. USE OF ELECTRICAL JUNCTION BOX RECOMMENDED.
 4. REFER TO ENCELLIUM UNIVERSAL I/O-MODULE INSTALLATION AND SERVICE MANUAL BEFORE INSTALLING OR SERVICING MODULE.
 5. CONTACT ENCELLIUM FOR COMPATIBILITY WITH OTHER DEVICES.

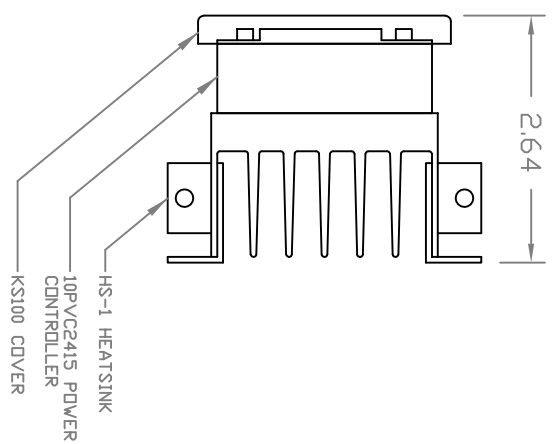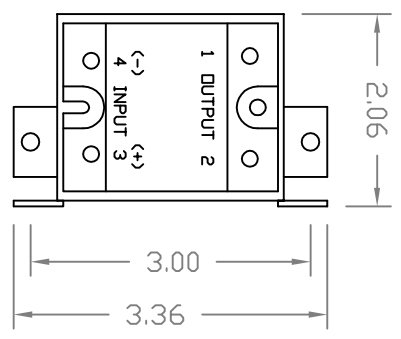

REV	DESCRIPTION/CHANGE	DATE



 68 LEEK CRESCENT, UNIT A, RICHMOND HILL, ON L4B 1H1, CANADA

 TEL: 905-731-7678
 FAX: 905-731-1401
 www.enceillum.com

TITLE **INCAND. DIMMING MODULE-10M**

SCALE NTS	PROJ. NO.	SIZE
DRAWN A. PARKER	DWG. NO. 77-009-AA	A
DATE 28-JAN-05	FILE NAME CS-IDM-10M.dwg	